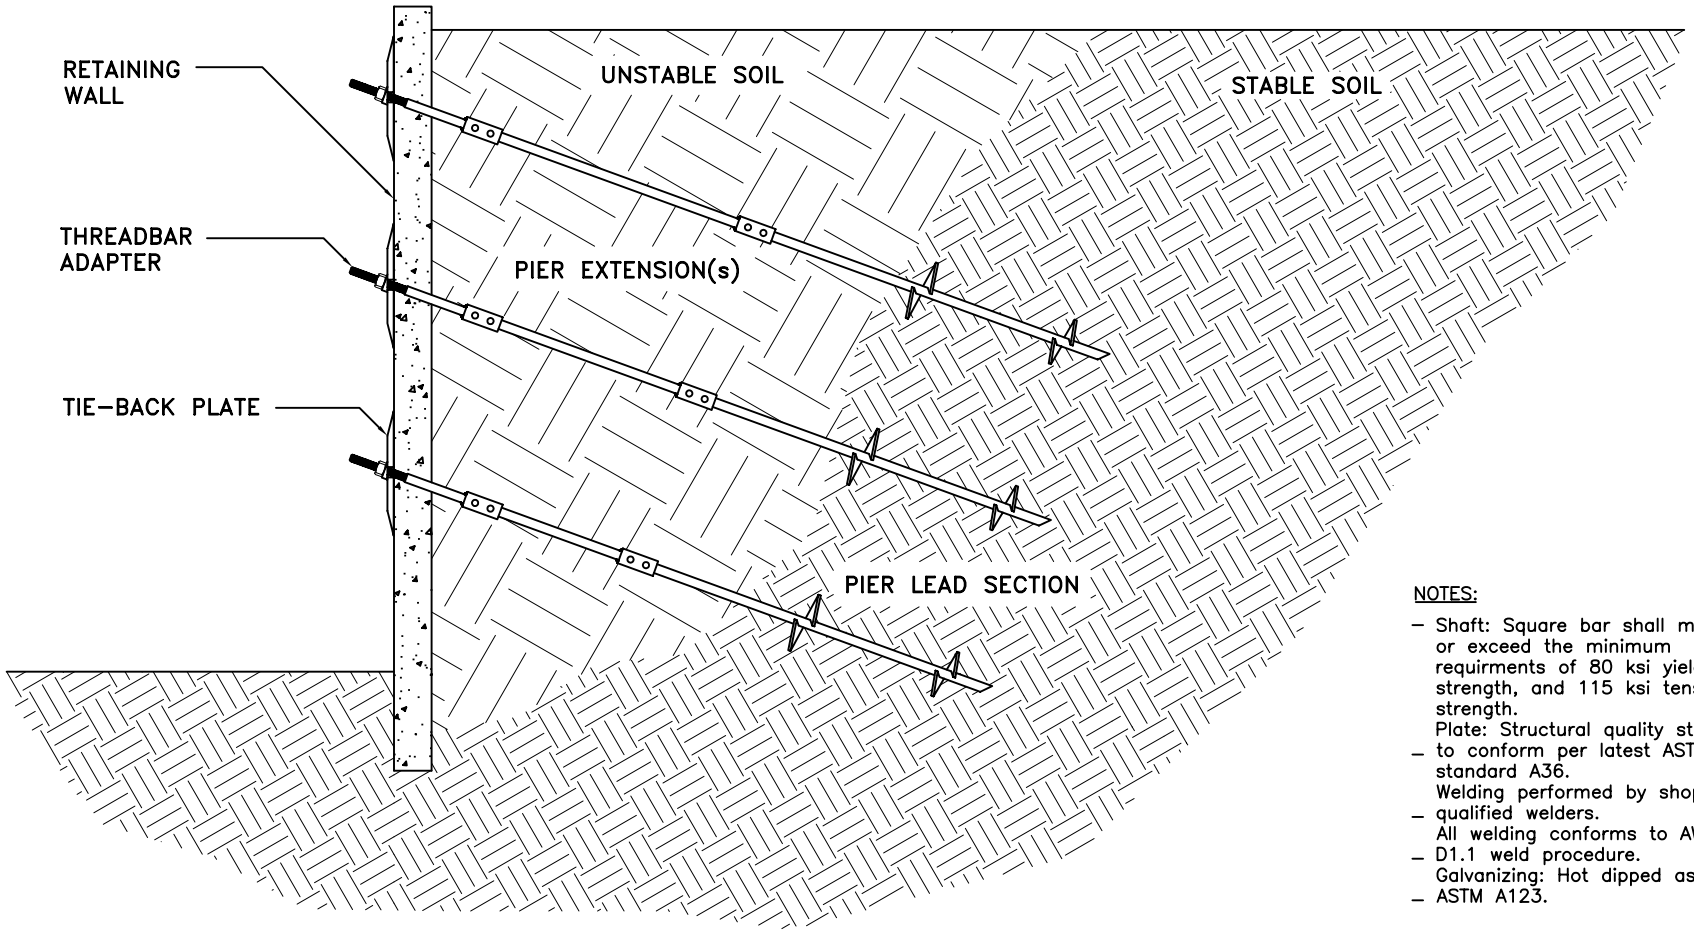

NOTES:

- Shaft: Square bar shall meet or exceed the minimum requirments of 80 ksi yield strength, and 115 ksi tensile strength.
- Plate: Structural quality steel to conform per latest ASTM standard A36.
- Welding performed by shop qualified welders.
- All welding conforms to AWS D1.1 weld procedure.
- Galvanizing: Hot dipped as per ASTM A123.

NUMBER	REVISION	DRWN BY	CHECKED	DATE
		BH	RR	22/11/05

PierTech SYSTEMS

TITLE:

RETAINING WALL

TIE BACK

SCALE	DRAWING NUMBER	REV.
N.T.S.	FR250LB1	A